

EXL-IMU-1

EXL-IRU-1

ExMax-...“S”

ExVent-...

ExMax-...“M”



ACVATIX™

## HVAC regulations in areas

EX...

Hazardous areas or potentially explosive atmospheres

**Non explosion-proof Siemens components in conjunction with “ex-protected” products from Schischek are sufficient to satisfy the stringent demands of EX-PROTECTION, provided the relevant application and mounting instructions are followed.**

### Application

#### HVAC market

In the electrical and mechanical building services industry, potentially explosive atmosphere are often not identified in the early planning stages. This results in unsafe systems and costly refits.

Examples:

- Exhaust and recirculation systems
- Ventilation systems
- Battery rooms and solvent stores
- Dumps and bottling plants
- Paint spraying systems and workshops
- Clean rooms

<b>Industrial-Chemical-Pharmaceutical market</b>	Industrial, chemical, pharmaceutical, petro-chemical and process control plant are often associated with explosive atmospheres requiring a variety of explosion-protection strategies.
	<p>Examples:</p> <ul style="list-style-type: none"> <li>• Manufacturing &amp; process plants</li> <li>• Waste and water treatment works</li> <li>• Transport and filling stations, storage facilities</li> <li>• Paint spraying systems and paint stocks</li> <li>• Dust generating plant</li> <li>• Silos and mills</li> </ul>

## Explosion proof standards

---

<b>Standards and directives</b>	From 1 July 2003 the construction of explosion-protected electrical equipment must comply with the regulations set out in Directive 94/9/EC (ATEX 100a). These new regulations cover all member states and must be observed when operating in potentially hazardous areas.
	Directive 1999/92/EC (ATEX 118a) which will soon be in force, will serve as a uniform classification of explosive risk systems and consequently as the basis for the selection and classification of systems and equipment, including their installation. The ExVo ( <i>Explosionsschutzverordnung/Germany</i> ) is the German statutory provision for the introduction of Ex products onto the market, and the ElexV ( <i>Verordnung über elektrische Anlagen in explosionsgefährdeten Bereichen/Germany</i> ) is the German statutory provision for the installation and operation of electrical products in potentially explosive atmospheres. Please observe the relevant national regulations for your home country.
<b>Standard specifications</b>	94/9/EG - ATEX 1999/92/EG - ATEX 118a ElexV, ExVO EN 50014 to EN 50028
<b>Certificates</b>	For electrical, explosion-proof devices, special registration and certification is required. Ex-products must be registered with the official bodies (in Germany, for example, the PTB ( <i>Physikalisch-Technische Bundesanstalt</i> in Braunschweig)). In Europe there are currently 13 officially registered testing institutes. Certification in accordance with the ATEX directives will also be accepted in many countries outside Europe.

## Labelling


The label must show the following:

Name and address of manufacturer, type code, electrical data (V, A, W, Hz), ambient temperatures if other than -20°C to +40°C and explosion protection classification:

<b>Ex II2G EEx d IIC T6 (gas) II2D IP65T95°C (dust)</b>	
<b>CE 0158 , PTB 99 ATEX 1103</b>	
CE	CE-sign
0158	Number of the named authority
PTB 99 ATEX 1103	Authority and registration number
Ex	Sign in acc. with European conformity
Gruppe und Kategorie	II 2 G/ II 2 D
EEx	European conformity
d	Type of protection (e.g. „d“ = flameproof enclosure)
IIC	Explosion group
T6	Temperature class

In addition, the serial number of the device must be shown.

## Example: label for valve actuator

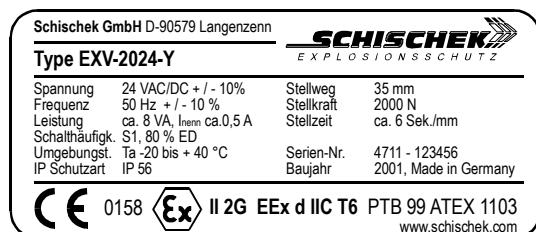

The label has to meet special technical requirements.

## Protection type

There are different types of protection which define the construction of the product. These protection types are in accordance with the CENELEC regulations (EN 50014 to 50028).

Example of the most important protection types:

EN 50014	Common regulations
EN 50018	"d" Flameproof enclosure
EN 50019	"e" Increased safety
EN 50020	"i" Intrinsic safety
EN 50028	"m" Encapsulation

## Explosion group

This is a measure of the ignition potential in a dangerous explosive atmosphere.

The demands placed upon the product increase in stringency from IIA to IIC:

IIA	Minimum protection required
IIB	Average protection required
IIC	Maximum protection required

## Temperature class

The temperature class depends on the material, and indicates the maximum admissible surface temperature of the product, in relation to an ambient temperature of + 40°C.

It does not indicate the operating temperature of the product, but relates, instead, to the product's own maximum temperature and therefore to the risk that it may act as a source of ignition.

T1 ≤ 450 °C      T2 ≤ 300 °C      T3 ≤ 200 °C  
T4 ≤ 135 °C      T5 ≤ 100 °C      T6 ≤ 85 °C

## Classification of potentially explosive atmospheres

Depending on the product classification, products can be installed in the following zones:

Classification of Ex area	Group	Category	Application for
Zone 0	II	1 G	Gases – vapors –mists
Zone 1	II	1 G, 2G	Gases – vapors – mists
Zone 2	II	1 G, 2G, 3G	Gases – vapors – mists
Zone 20	II	1 D	Dusts
Zone 21	II	1 D, 2 D	Dusts
Zone 22	II	1 D, 2 D, 3 D	Dusts
Zone 0 and 20		Explosive atmosphere always or often present	
Zone 1 and 21		Explosive atmosphere occasionally present	
Zone 2 and 22		Explosive atmosphere rarely present or present only for short periods	

## Source of ignition

Hot surfaces – mechanically produced sparks – visible electric sparks – static electricity – equalizing electric currents– open flames – hot gases – hot particles – ultrasound – electromagnetic radiation (radio waves, IR radiation, visible light) – ionized radiation– ultraviolet rays.

## Examples of safety engineering characteristics

Medium	Explosion group	Temperature class
Acetone	IIA	T1
Acetylene	IIC	T2
Fuel oil/gas	IIA	T3
City gas	IIB	T1
Sulphur carbon	IIC	T6
Hydrogen	IIC	T1

## Type overview

### EX-LINE series

Ex protected measuring transducers and switching modules for connection to passive sensors:

Ex-products II(1)GD [EEx ia/b] IIC, for passive sensors and passive switching devices in hazardous areas				
Stepless measuring transducers				Binary signals (switching modules)
Temperature	Humidity	Pressure	Setpoint	Temperature, frost protection, humidity, pressure
<b>EXL-IMU-1</b>				<b>EXL-IRU-1</b>
				
AC/DC 24 V		AC/DC 24 V		
II(1)GD [EEx ia] IIC (IIB)		II(1)GD [EEx ia] IIC (IIB)		
Programmable without additional tools, 2-3-4 wire connection, output 0..10 VDC and 4...20 mA actual value indication, failure indication, housing 45 x 75 x 110 mm, DIN rail mounting			Integral time running relais, adjustable housing 22,5 x 75 x 100 mm DIN rail mounting Installation area is he safe area	
Installation area is he safe area				

## Combinations of EXL... transducers and switching modules in acc. with ATEX certified sensors

Temperature measurement in hazardous areas zone 1, 2, 22 (passive sensors)					
Application	Use	Type	Use	Type	Output
	Measuring range	Sensor	Ex-area	Ex-product	Ex-product
Room temperature, Pt 100	-30 to +60 °C	TFR-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Room temperature, Pt 100, IP65	-50 to +90 °C	TFR-2G3D	Zone 1, 2, 22	EXL-IMU-1	DC 0...10 V
Duct temperature, Pt 100, IP65	-30 to +60 °C	TFK-2G3D	Zone 1, 2, 22	EXL-IMU-1	DC 0...10 V
Immersion temperature, Pt 100, IP65, tube G ½" Ms, 100 mm	-30 to +150 °C	TFT-2G3D	Zone 1, 2, 22	EXL-IMU-1	DC 0...10 V
Immersion temperature, Pt 100, IP65, tube G ½" VA, 100 mm	-30 to +150 °C	TFT-V4A-2G3D	Zone 1, 2, 22	EXL-IMU-1	DC 0...10 V
Humidity measurement in hazardous areas zone 1, 2 (passive sensors)					
Application	Use	Type	Use	Type	Output
	Measuring range	Sensor	Ex-area	Ex-product	Ex-product
Room humidity, 0...1 KOhm	30 to 100 % r.H.	FFR-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Duct humidity, 0...1 KOhm	30 to 100 % r.H.	FFK-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Combination of temperature and humidity measurement in hazardous areas zone 1, 2 (passive sensors)					
Application	Use	Type	Use	Type	Output
	Measuring range	Sensor	Ex-area	Ex-product	Ex-product
Room humidity and temperature, 0...1 KOhm, Pt 100	30...100 %rH, -10 bis +60°C	TFFR-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Duct humidity and temperature, 0...1 KOhm, Pt 100	30...100 %rH, -20 bis +60°C	TFFK-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Differential pressure measurement in hazardous areas zone 1, 2, 22 (passive sensors)					
Application	Use	Type	Use	Type	Output
	Measuring range	Sensor	Ex-area	Ex-product	Ex-product
Differential pressure	up to 700 Pa	DFK-07-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Differential pressure	up to 1700 Pa	DFK-17-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Volume control	0...15 m/s	VFK-07-2G	Zone 1, 2	EXL-IMU-1	DC 0...10 V
Setpoint regulation in hazardous areas zone 1, 2, 22 (passive sensors)					
Application	Use	Type	Use	Type	Output
	Measuring range	Sensor	Ex-area	Ex-product	Ex-product
Setpoint-(Potentiometer-)sensor, 0...1 KOhm	0...1 KOhm	SGR-2G3D	Zone 1, 2, 22	EXL-IMU-1	DC 0...10 V
Binary signals in hazardous areas zone 1, 2, 22 (passive sensors)					
Application	Use	Type	Use	Type	Output
	Measuring range	Sensor	Ex-area	Ex-product	Ex-product
Room thermostat	0 to +40°C	TBR-2G	Zone 1, 2	EXL-IRU-1	Kontakt
Room thermostat, IP65	-30 to + 30°C	TBR-2G3D	Zone 1, 2, 22	EXL-IRU-1	Kontakt
Duct thermostat, IP65, L=190 mm	0 to +60°C	TBK-2G3D	Zone 1, 2, 22	EXL-IRU-1	Kontakt
Duct thermostat, IP65, L=120 mm	20 to +90°C	TBT-2G3D	Zone 1, 2, 22	EXL-IRU-1	Kontakt
Frost protection thermostat, Kapillare 6 m	-10 to +12°C	TBK-FR-2G	Zone 1, 2	EXL-IRU-1	Kontakt
Room humidistat	35 to 100 % r.H.	FBR-2G	Zone 1, 2	EXL-IRU-1	Kontakt
Duct humidistat	35 to 100 % r.H.	FBK-2G	Zone 1, 2	EXL-IRU-1	Kontakt
Differential pressure control	20-300/50-500/100-1000 Pa	DBK-2G	Zone 1, 2	EXL-IRU-1	Kontakt
Differential pressure control, IP65	40-125/100-400/350-1400 Pa	DBK-2G3D	Zone 1, 2, 22	EXL-IRU-1	Kontakt
Air paddle thermostat, paddle in V2A version	2 to 8 m/s	WFBK-2G	Zone 1, 2	EXL-IRU-1	Kontakt
Fan belt protection via Namur sensor	up to 20.000 m³/h	NBW-K-2G3D	Zone 1, 2	EXL-IRU-1	Kontakt
Fan belt protection via Namur sensor	> 20.000 m³/h	NBW-G-2G3D	Zone 1, 2	EXL-IRU-1	Kontakt

Transducer

All transducer Type EXL-IMU-1 are designed for rail mounting as standard

Switching modules

All switching modules Type EXL-IRU-1 are designed for rail mounting as standard

Sensors

All sensors carry a manufacturers certificate in acc. with ATEX, if used together with EXL-IRU-1 or EXL-IMU-1

## ExMax series

Actuators II2G EEx d IIC T6 (gas) and II2D IP65T95°C (dust)  
for air and fire dampers

Type

Actuators for use on air and fire dampers			
Size S		Size M	
ExMax- 5.10 ... ExMax- 15.30...	ExMax-5.10-F ExMax-15-F	ExMax-50.75 ExMax-100	ExMax-30-F ExMax-50-F
			
5 and 10 Nm 15 and 30 Nm	5 and 10 Nm 15 Nm	50 and 75 Nm 100 Nm	30 Nm 50 Nm
95 ° rotation	95 ° rotation	95 ° rotation	95 ° rotation
3/15/30/60/120 sec	3/15/30/60/120 sec	60/90/120/180 sec	60/90/120/180 sec
	Spring return in 3 and 10 sec		Spring return in 20 sec

**Note:** All actuators have a double squared shaft connection, size S = 12 x 12 mm, size M = 16 x 16 mm  
**Universal clamp for round damper shafts:** Additional type KB-S up to max. 30 Nm

Type of actuator

Type of actuator			ExMax-5.10	ExMax-15.30	ExMax-50.75	ExMax-100
	Supply voltage	Control signal	Type	Type	Type	Type
Actuators	AC/DC 24... 230 V	On-off, 3-pos	ExMax-5.10	ExMax-15.30	ExMax-50.75	ExMax-100
	Self adjustment	0..10 VDC, 4..20 mA	ExMax-5.10-Y	ExMax-15.30-Y	ExMax-50.75-Y	ExMax-100-Y
Type of actuator			ExMax-5.10-F	ExMax-15-F	ExMax-30-F	ExMax-50-F
Actuators	AC/DC 24... 230 V	On-off, 3-pos	ExMax-5.10-F	ExMax-15-F	ExMax-30-F	ExMax-50-F
	Self adjustment	0..10 VDC, 4..20 mA	ExMax-5.10-YF	ExMax-15-YF	ExMax-50-YF	ExMax-50-YF
Accessories			Type suffix	Type suffix	Type suffix	Type suffix
Easy grip manual override			HV-S	HV-S	HV-M	HV-M
External, adjustable aux. switches (2 contacts)			ExSwitch	ExSwitch	ExSwitch	ExSwitch
EEx-e terminal boxes (different types)			ExBox..	ExBox..	ExBox..	ExBox..
Mounting brackets for ExBox devices directly to the actuator			MKK-S	MKK-S	MKK-M	MKK-M
Stainless steel version			ExMax-.../VA	ExMax-.../VA	ExMax-.../VA	ExMax-.../VA

ExMax actuators are working from 24 VAC/DC to 230 VAC/DC self adjustable, 50...60 Hz. Motor running times adjustable on site.

Required data for order  
and delivery

Order information
1. Actuator type
2. Type suffix for selected accessories
<b>Example:</b>
Actuator, 30 Nm, 3-pos, terminal box + mounting bracket for terminal box
Actuators type: <b>ExMax-15.30</b>
Accessories: <b>ExBox-3P + MKK-S</b>
<b>Delivery</b>
Actuators are delivered without EEx e terminal box.
<b>Ex-protection in respect of all gases, vapors, mists and dust:</b>
II2G EEx d IIC T6 (gas) and II2D IP65T95°C (dust)

**EX-VENT series**

Valve actuators II2G EEx d IIC T6 (gas) and II2D IP65T95°C for fitting to Siemens valves

## Type

Actuators for valves			
Type			
EXV-8...	EXV-8...-F16	EXV-20...	EXV-45...
			
<b>800 N</b>	<b>800 N</b>	<b>2000 N</b>	<b>4500 N</b>
6 sec/mm	5 sec/mm	6 sec/mm	2.5 sec/mm
max. 42 mm	max. 30 mm	max. 42 mm	max. 35 / 75 mm
	<b>Spring return in 10 ... 16 s</b>		

**Note:** With the spring return version, please indicate the required failsafe position when ordering i.e. spindle retracted when de-energized = .../RI; , spindle extended when de-energized = .../RO

## Type

Actuator type		EXV-8	EXV.8...-F16	EXV-20...	EXV-45...	
	Supply voltage	Control mode	Type	Type	Type	
Actuator	AC 230 V	On-off	EXV-8230	EXV-8230-F16/R..	EXV-20230	
		3-pos	EXV-8230	-	EXV-20230	
		3-pos P 1 KOhm	EXV-8230-P	-	EXV-20230-P	
		DC 2...10 V	EXV-8230-Y	-	EXV-20230-Y	
Actuator	AC/DC 24 V	On-off	EXV-824	EXV-824-F16/R..	EXV-2024	
		3-pos	EXV-824	-	EXV-2024	
		3-pos P 1 KOhm	EXV-824-P	-	EXV-2024-P	
		DC 2...10 V	EXV-824-Y	EXV-824-YF16/R..*	EXV-2024-Y	
Accessories		Type suffix	Type suffix	Type suffix	Type suffix	
Manual override		EXV-.../HV	EXV-.../HV	EXV-.../HV	EXV-.../HV	
External auxiliary switches, fully adjustable		EXV-.../HSV	EXV-.../HSV	EXV-.../HSV	EXV-.../HSV	
EEx-e junction box for auxiliary switches		EXC-K/HSV	EXC-K/HSV	EXC-K/HSV	EXC-K/HSV	
Internal heater for temperature to -20 °C		EXV-.../K	EXV-.../K	EXV-.../K	EXV-.../K	
AISI 316 stainless steel housing		EXV-.../VA	EXV-.../VA	EXV-.../VA	EXV-.../VA	

\* Items marked with\* are only manufactured for AC 24 V / 50 Hz; a DC 24 V version is not available

Required data for order  
and delivery

**Order information**

1. Actuator type
2. Type suffix for accessories
3. With spring return, indicate failsafe position  
(RI = spindle retracted on loss of power, RO = spindle extended on loss of power)
4. Valve type, size, DN, stroke

**Example:**

Spring return 800 N force, AC 24 V supply, 0-10 V modulating control, 2 aux. switches, spindle retracted when de-energized:

Actuator type                   **EXV-824-YF16/2EE/RI**  
 Valve type                      **VVG41.15**

**Included**

Actuators are supplied with an EEx e junction box and linkage to fit the Siemens type VVG 41.15 valves

**Explosion protection in respect of all gases, vapors, mists and dusts:**



## Combinations of actuators II2G EEx d IIC T6 (gas) and II2D IP65T95°C and Siemens valve types

Siemens valve type compatible with Schischek Ex-actuators									
Control mode	On-off	3-pos	3-pos-P (Feedback potentiometer 1000 Ohm)	3-pos-P (Feedback potentiometer 1000 Ohm)	SR ~ 16 s	SR ~ 16 s	Continuous control 0(2)...10V...0(4)...20 mA		
Spring return (SR)	SR ~ 16 s	without	without	without			None		
<b>Force</b>	<b>800 N</b>	<b>800 N</b>	<b>2000 N<sup>1)</sup></b>	<b>2000 N</b>	<b>4500 N<sup>1)</sup></b>	<b>2000 N</b>	<b>4500 N<sup>1)</sup></b>	<b>800 N</b>	<b>800 N</b>
Supply voltage	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V	AC/DC 24 V AC 230 V
Stroke max.	20 mm	20 mm	40 mm	40 mm	20 mm	40 mm	20 mm	20 mm	40 mm
<b>Ex -actuator type</b>	<b>EXV-8...-F16</b>	<b>EXV-8...-P</b>	<b>EXV-20...-P</b>	<b>EXV-8...-P</b>	<b>EXV-45...-P</b>	<b>EXV-20...-P</b>	<b>EXV-8...-Y-F16</b>	<b>EXV-8...-Y</b>	<b>EXV-20...-Y</b>
<b>Flanged valves 2- and 3-way</b>									
2-way	PN 6	VVF21	DN 25 - 80	DN 100	DN 100	DN 25 - 80	DN 100	DN 100	DN 100
3-way	PN 6	VXF21	DN 25 - 80	DN 100	DN 100	DN 25 - 80	DN 100	DN 100	DN 100
2-way	PN 10	VVF31	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 100 - 150
3-way	PN 10	VXF31	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 100 - 150
2-way	PN 16	VVF40	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 100 - 150
3-way	PN 16	VXF40	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 25 - 80	DN 100 - 150	DN 100 - 150	DN 100 - 150
2-way	PN 16	VVF41	DN 50	DN 50	DN 65 - 150	DN 50	DN 65 - 150	DN 50	DN 50
3-way	PN 16	VXF41	DN 15 - 50	DN 15 - 50	DN 65 - 150	DN 15 - 50	DN 65 - 150	DN 15 - 50	DN 15 - 50
2-way	PN 25	VVF52	DN 15 - 40	DN 15 - 40	DN 15 - 40	DN 15 - 40	DN 15 - 40	DN 15 - 40	DN 15 - 40
2-way	PN 40	VVF61 <sup>2)</sup>	DN 15 - 50	DN 65 - 150	DN 65 - 150	DN 15 - 50	DN 65 - 150	DN 15 - 50	DN 65 - 150
3-way	PN 40	VXF61 <sup>2)</sup>	DN 15 - 50	DN 65 - 150	DN 65 - 150	DN 15 - 50	DN 65 - 150	DN 15 - 50	DN 65 - 150
<b>Screwed valves 2- and 3-way</b>									
2-way	PN 16	VVG41	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50
3-way	PN 16	VXG41	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50	DN 15 - 50

<sup>2)</sup> Valves VVF61.. and VXF61.. from DN 40 to DN 150 must close against the flow! (Please contact us for more details)

<b>Siemens</b>	<b>Force</b>	<b>Stroke</b>	<b>Schischek</b>
SQX	700 N	20 mm	EXV-8
SKD	1000 N	20 mm	EXV-20
SKB/SKC	2800 N	40 mm	EXV-45

Refer to the relevant Siemens data sheets for the admissible pressure drops for the type VVF/NXF21- 61..., VVG/VXG41 valves...

**ExMax size M series**

Actuators II2G EEx d IIC T6 (gas) and II2D IP65T95°C (dust)  
for butterfly valves

## Size

Actuators for butterfly valves	
Size M	Size M
ExMax-100	ExMax-50-F
	
<b>100 Nm</b>	<b>50 Nm mit Federrücklauf 20 Sek</b>
95 ° rotation	95 ° rotation
~ 60/90/120/180 sec.	~ 60/90/120/180 sec.
Double squared shaft connection 16 x 16 mm	Double squared shaft connection 16 x 16 mm

## Type of actuators

Type of actuators	Supply voltage	Control mode	ExMax-100	ExMax-50-F
		Type	Type	Type
Actuators	AC/DC 24... 230 V	On-off, 3-pos	ExMax-100	ExMax-50-F
		0..10 VDC, 4...20 mA	ExMax-100-Y	ExMax-50-YF
		Spring return	ohne	50 Nm
Accessories		Type suffix	Type suffix	
Manual override		HV-M	HV-M	
External auxiliary switches, fully adjustable		ExSwitch	ExSwitch	
EEx-e junction box for auxiliary switches		ExBox-..	ExBox-..	
Internal heater for temperature to -20 °C		MKK-M	MKK-M	
AISI 316 stainless steel housing		ExMax-.../VA	ExMax-.../VA	

Combination with  
Siemens butterfly valves

Actuators II2G EEx d IIC T6 (gas) and II2D IP65T95°C (dust)  
in combination with Siemens butterfly valves

Siemens butterfly valves and Schischek Ex-actuators				
Control mode	On-off, 3-pos	DC 0...10 V	On-off, 3-pos	DC 0...10 V
Spring return	without	without	20 sec	20 sec
Torque	100 Nm	100 Nm	50 Nm	50 Nm
Supply voltage	AC/DC 24...230 V	AC/DC 24...230 V	AC/DC 24...230 V	AC/DC 24...230 V
Rotation	95°	95°	95°	95°
Ex-actuator type	ExMax-100	ExMax-100-Y	ExMax-50-F	ExMax-50-YF
Flange EN 12116   Butterfly valves				
F04	DN 40 - 65			
F05	DN 80 - 125			

## Note:

For sizes > DN 150 please contact us for assistance.

The permissible pressure drop s in acc. with Siemens data sheet 4136 for VKF46.... .

Required data for order  
and delivery**Order information:**

1. Actuator type
2. Type of suffix for accessories

**Example:**

Rotary actuator, 50 Nm, 3-pos, spring return

Actuator type      **ExMax-50-F**

Valve type          **VKF46.100**

**Delivery:**

Actuators are delivered without an EEx e terminal box.

**Explosion protection in respect of all gases, vapors, mists and dusts:**

II 2 G EEx d IIC T6 (and II 2 D EEx d IIC T6 in preparation)

## Installation

---


Preliminary remarks	Ensure that these notes are available and have been read prior to installation.
Applicable standard	The installation of electrical systems in Group II explosive atmospheres is governed by the regulations in IEC 60 079-14 (EN60071-14).
	For installation in a safe area, the normal industry standards should be observed. However, for hazardous areas, special measures must be taken. This applies in particular to intrinsically safe (IS) electric circuits.
Electrical circuits, protection types d, e, q, o, m, p	Installation in the control panel is as "normal", but account must be taken of the special characteristics of the connected EEx equipment. This includes, for example, voltages, currents, fuses and motor protection equipment etc. The requirements for specific products are described in the associated test certificates, standards, and regulations, and the operator manuals. Never work on circuits in a potentially explosive atmosphere (e.g. when connecting a junction box), unless the equipment has been isolated (voltage/current disconnected). Always disconnect EEx-e junction boxes from the power supply before opening them.
Electrical circuits, protection type „i“ intrinsically safe	Intrinsically safe and non intrinsically safe circuits must be routed separately. Minimum distances between conductors must be observed and no inadmissible external inductance or capacitance may be produced by cables. The maximum permissible electrical limits of EEx-i equipment must be observed at all times. There should be no links between intrinsically safe and non intrinsically safe circuits. However, links between two different intrinsically safe circuits are allowed, provided the maximum rating is calculated in advance. Intrinsically safe circuits should be clearly marked as such.  Intrinsically safe circuits should be identified by the color light blue. This color is recommended for all intrinsically safe circuits in order to avoid confusion or accidental connection to non intrinsically safe circuits, e.g. conductors, cables, trunking, terminals, connection boxes, etc.
	A distance of 50 mm between intrinsically safe and non intrinsically safe circuits must be allowed, and the distance between two intrinsically safe circuits should be 6 mm. On installation, the cables of intrinsically safe and non intrinsically safe circuits must be routed separately.  In acc. with ATEX sensors for zone 1, 2 and 22 need a manufacturers certificate, for zone 21 sensors must be tested by an offical authority..
Suggestion for the layout of a switching and control system	A clear separation between intrinsically safe and non intrinsically safe equipment is necessary. It is recommended that sufficient distance be allowed between intrinsically safe and non intrinsically safe equipment during the planning stage, as the cost of remedying the situation later can be considerable. Large transformers, frequency converters, large relays and other electrical equipment which may influence intrinsically safe circuits by inductance or capacitance must be installed at a sufficient distance apart. As a precaution, the EEx-i devices should be provided with a suitable cover to protect them from inappropriate operation. All relevant standards and regulations must be observed.

## Applications

Applications in hazardous areas zones 1, 2, 21 and 22 (examples)


### Temperature and humidity control

#### Heating/Cooling

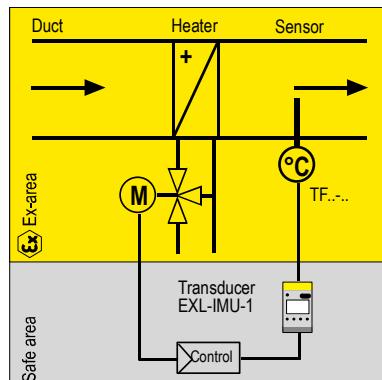

**Sensor (TF...)** in Ex-area  
**Transducer (EXL-IMU-1)** in safe area  
**Controller** (analog/digital) in safe area  
**Actuator** (motorized valve) in Ex-area


#### Humidity control

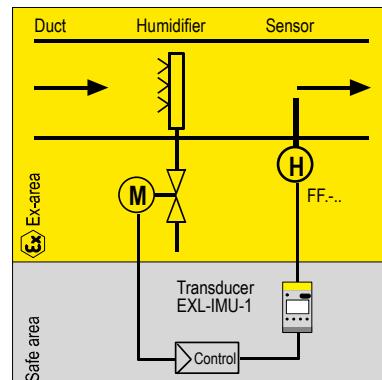

**Sensor (FF...)** in Ex-area  
**Transducer (EXL-IMU-1)** in safe area  
**Controller** (analog/digital) in safe area  
**Actuator** (motorized valve) in Ex-area


### Pressure control, thermostats, hygrostats

#### Pressure or volume control

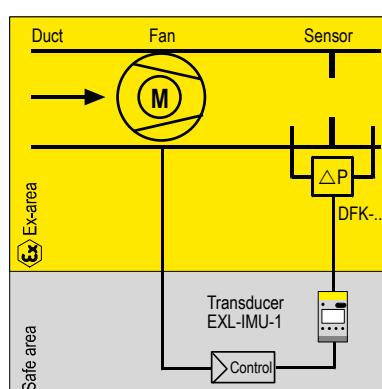

**Sensor (DFK...)** in Ex-area  
**Transducer (EXL-IMU-1)** in safe area  
**Controller** (analog/digital) in safe area


#### Temperature and humidity thermostats

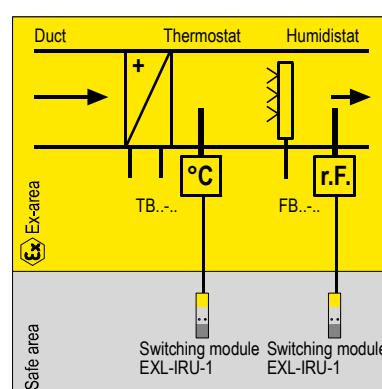

**Thermostat/Hygrostat** in Ex-area  
**Switching module (EXL-IRU-1)** in safe area


### Frost protection and differential pressure

#### Frost protection

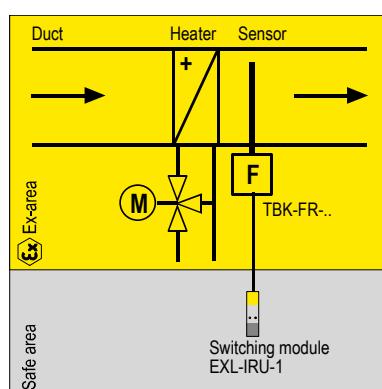

**Frost protection thermostat** in Ex-area  
**Switching module (EXL-IRU-1)** in safe area


#### Filter and drive belt monitoring

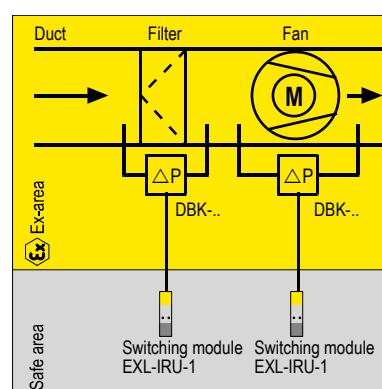

**Differential pressure sensor** in Ex-area  
**Switching module (EXL-IRU-1)** in safe area


## Damper control with and without feedback

### On-off control

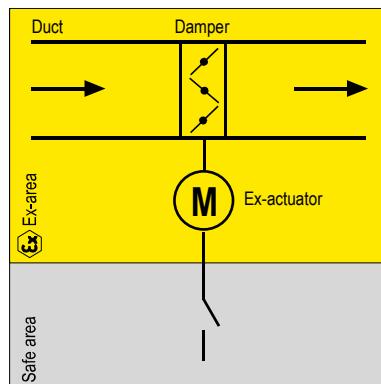

**Actuator in Ex-area**


### Automatic control

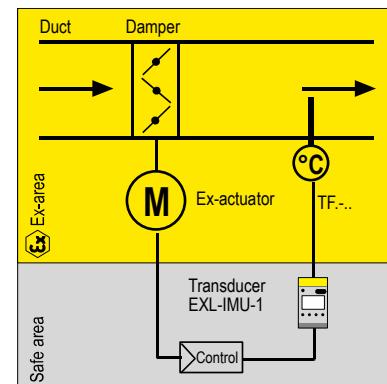

**Sensor (TF....) in Ex-area**  
**Transducer (EXL-IMU-1) in safe area**  
**Controller (analog/digital) in safe area**  
**Actuator (damper actuator) in Ex-area**

## Safety and fire dampers

### Safety and fire dampers

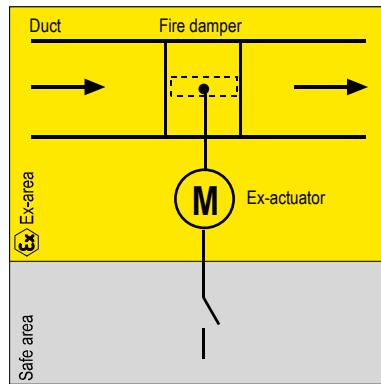

**Spring return actuator in Ex-area**